


A

B

C

D

## GLOBAL LP FW

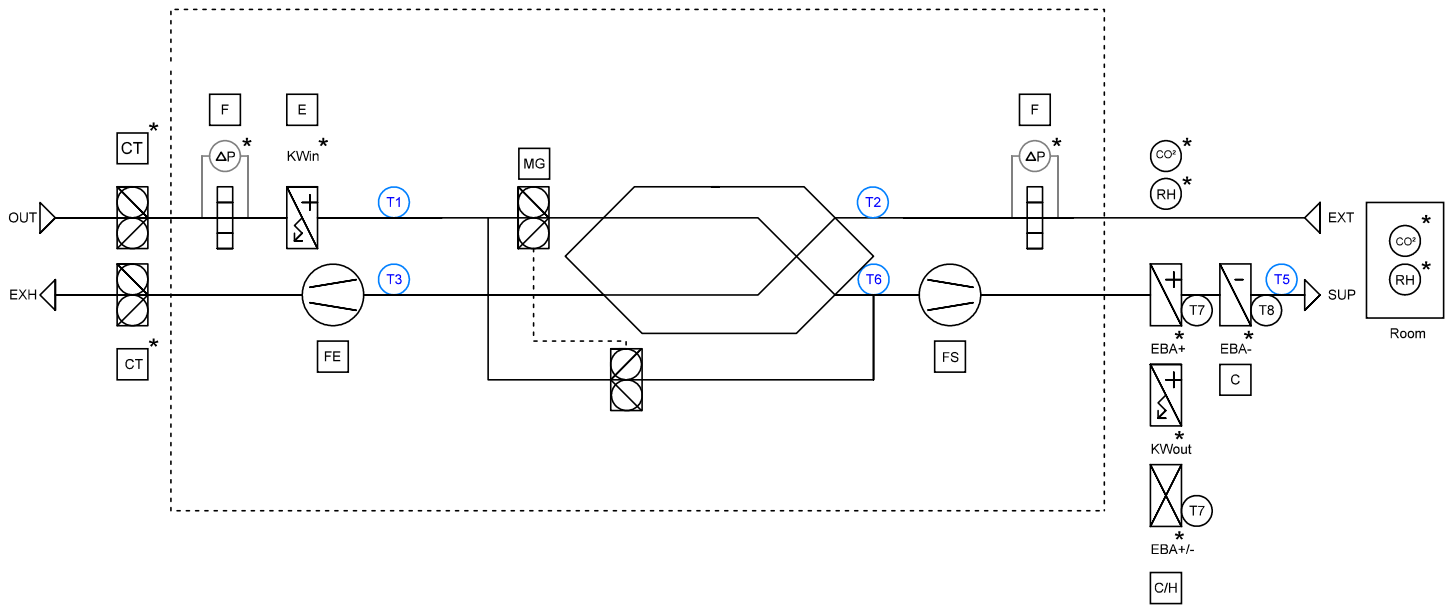

## Component

## Delivery

	Exhaust fan with EC drive		installed / wired / configured
	Supply fan with EC drive		installed / wired / configured
	Motorised damper CT		separately
	Heating		
	KWin* : Electrical coil "frost protection"		installed / wired / configured
	KWout* : Electrical post-heating coil		separately
	EBA* : Internal Water Heating coil		separately
	3-way valve, Valve actuator		separately
	Filter		installed
	OUT ePM1 50% (F7) / EXT ePM10 50% (M5)		
	Heating / Cooling		separately
	KW* : Electric heating		
	EBA+/- * : Change over coil		separately
	EBA-* : Cooling coil		separately
	Outdoor temp.		Exhaust temp.
	Extract temp.		Supply temp. (separately)
	Frost protection temp.		installed / wired / configured
	Frost protection temp.		separately
	Frost protection temp.		separately
	Sensors CO <sup>2</sup> , Humidity		separately
	Constant airflow kit		installed / wired / configured
	Pressure switch		separately
	Pressure sensor		installed / wired / configured

\*: Option

## Changes

## Name

## Date

Name

Date

Draw.:

Beckers

10.10.2018

check.:

Pary

Norm:

Subject:

GLOBAL\_Fow chart\_EN.sp17

GLOBAL LP FW